PUB SINGAPORE'S NATIONAL WATER AGENCY

COATED - PANTONE 2746
UNCOATED - PANTONE 072
PROCESS - 100c 90m

COATED - PANTONE 2935
UNCOATED - PANTONE 3005
PROCESS - 100c 50m

COATED - PANTONE 321
UNCOATED - PANTONE 320
PROCESS - 100c 50y 10k

DETAILS OF LOGO

SIZE OF LETTERING		FONT TYPE	STYLE
CAUTION	9MM	ARIAL	BOLD
Ø PW PIPE	10MM	ARIAL	BOLD
3.50M	5MM	ARIAL	BOLD
CALL 1800 - CALL PUB (2255 782)	6MM	ARIAL	BOLD
BEFORE ANY WORKS	5MM	ARIAL	BOLD

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
2. REFER TO THE GENERAL NOTES IN DRAWING NO. PUB/WSN/GN/001.
3. STAINLESS STEEL PLATES AND BOLTS SHALL BE OF GRADE 316.
4. MARKERS SHALL BE INSTALLED AT ALL PUB CHAMBERS, HYDRANTS AND AT INTERVALS OF NOT MORE THAN 100M AS DIRECTED BY S.O.
5. THE CONTRACTOR SHALL SUBMIT A SHOP DRAWING OF THE MARKER PLATE FOR THE APPROVAL OF THE S.O BEFORE FABRICATION.

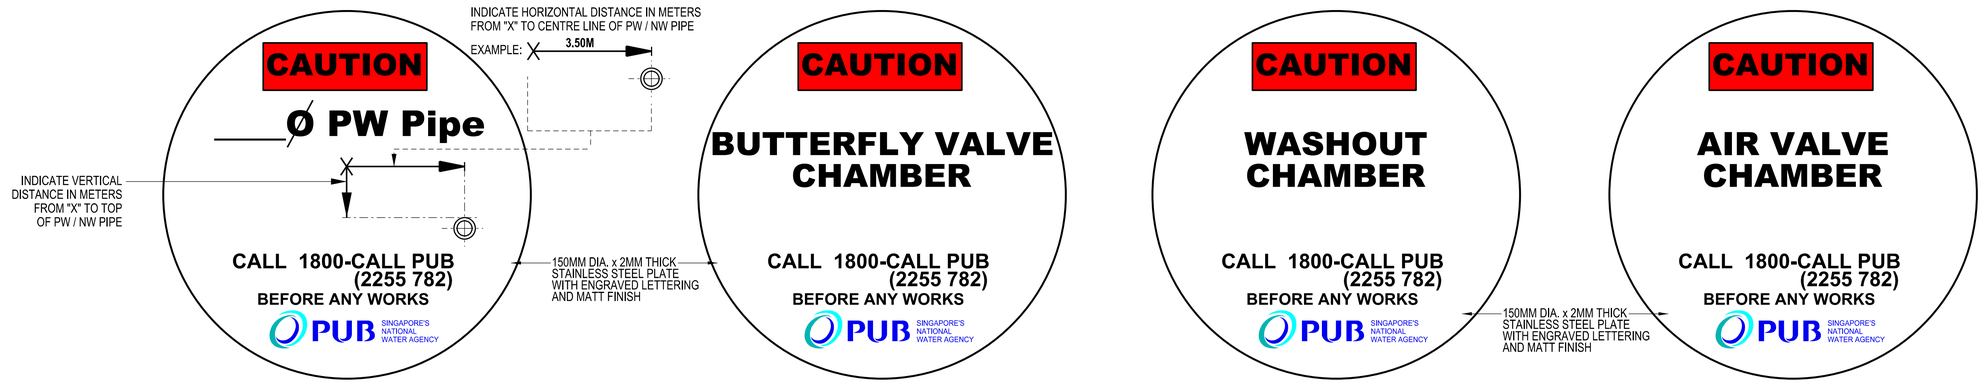

NOTE:
PW REFERS TO POTABLE WATER
FOR NEWATER, USE NW

VARIOUS STAINLESS STEEL MARKER PLATES
SCALE 1 : 2.5

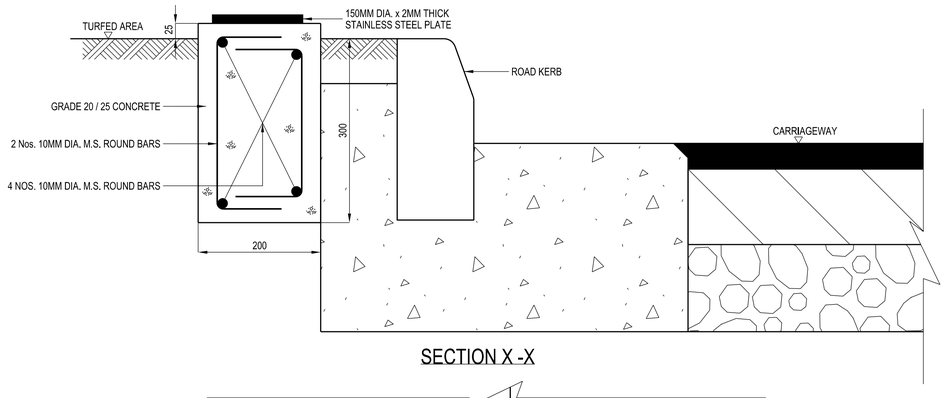

SECTION X -X

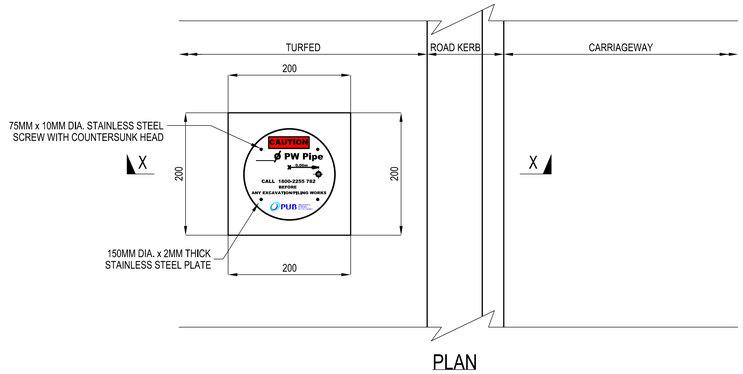

PLAN

GROUND MARKER ON TURFED AREA
SCALE 1 : 5

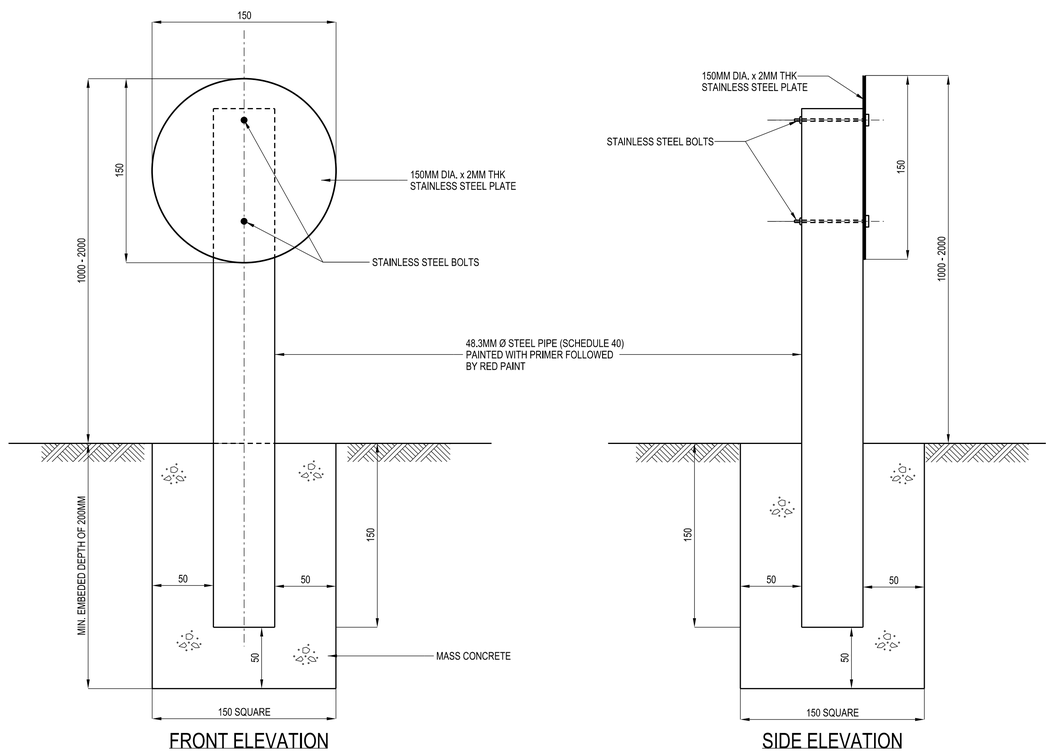

FRONT ELEVATION

SIDE ELEVATION

SIGNBOARD MARKER [FOR INSTALLATION OUTSIDE ROAD RESERVE (UNDEVELOPED AREA)]
SCALE 1 : 2.5

ISSUED : NOV 2020	SCALE	DRAWING NO.	GROUND AND SIGNBOARD MARKERS	PUB SINGAPORE'S NATIONAL WATER AGENCY
LAST REVIEWED : AUG 2021	AS SHOWN	PUB/WSN/STD/212		WATER SUPPLY(NETWORK) DEPARTMENT